




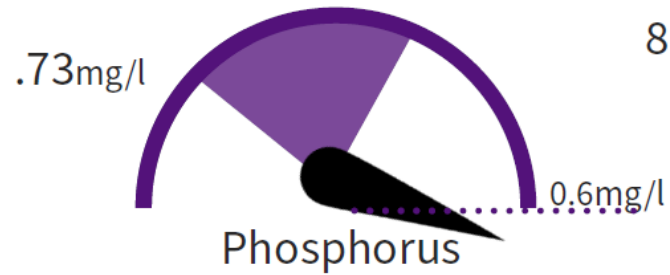

# November Operations Report

Presented by Alan Grooms

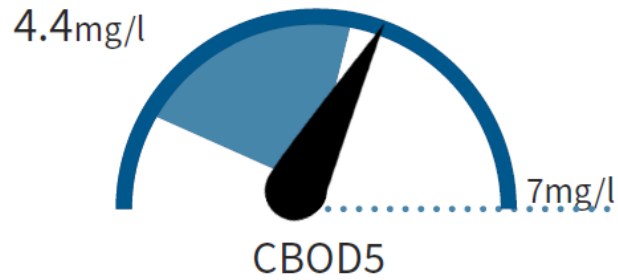


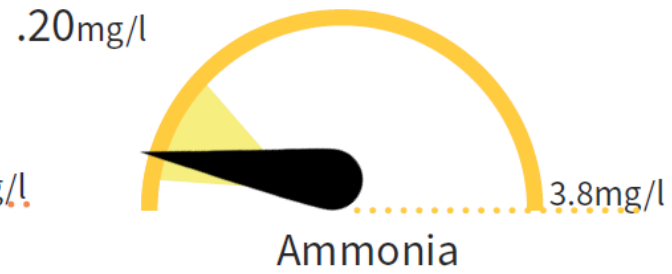

Shaded area represents one standard deviation around the 3-year average

# October Plant Performance

# Phosphorus Limits

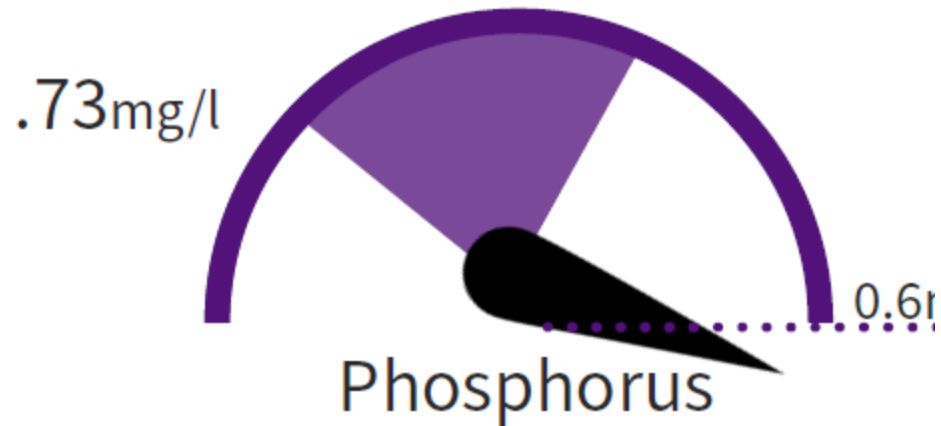

## Badfish Creek

- 0.6 mg/l on a 6-month average
- 8. • 1.0 mg/l on a monthly average
- Actual 6-month value 0.41 mg/l

## Badger Mill Creek

- Same limits on interim period
- Compliance on or before 9/30/2028 would be 0.075 mg/l



# Total Suspended Solids (TSS) Limits



## Badfish Creek

- 20 mg/l on monthly average
- 23 mg/l on a weekly average
- Also monthly total mass limits
  - (3,980 lbs in Oct / limit 7,180 lbs)

## Badger Mill Creek

- 10 mg/l on monthly avg (16 mg/l Nov-Apr)
- 17 mg/l on a weekly avg (27 mg/l Nov-Apr)
- No mass limit



# Questions?

